# Tes

Drawn:

DMH

Checked:

JRM

Approved:

JHB

Date:

04/05/22

Scale:

1:6

Sheet: 1 of 2


## T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

EC-3100-XP-LF10

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

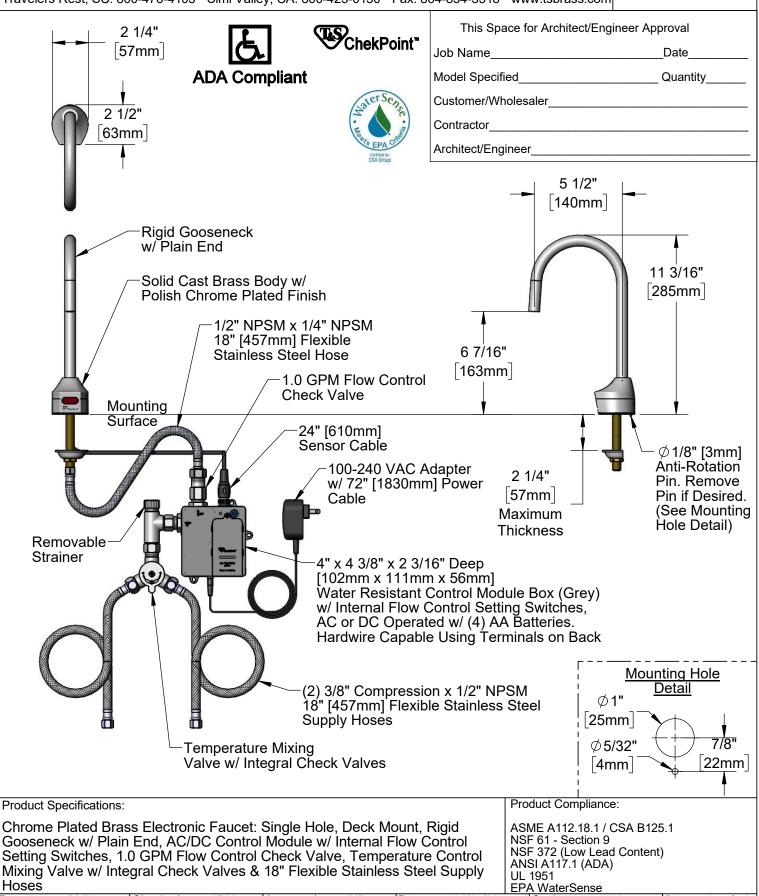



## T&S BRASS AND BRONZE WORKS, INC.


2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690

Model No.

EC-3100-XP-LF10

Item No.


Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

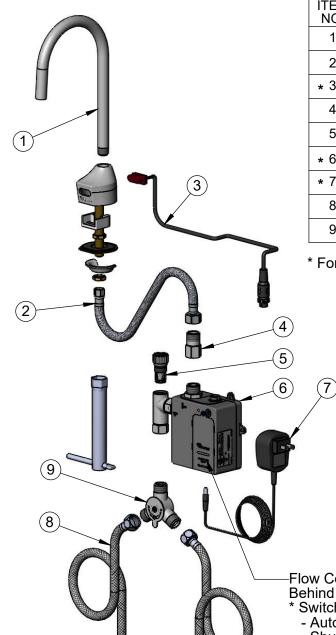

ITEM NO.	SALES NO.	DESCRIPTION
1	120XP	Rigid Gooseneck w/ Plain End
2	016297-45	Inlet Hose, Faucet, 1/2" NPSM-F x 1/4" NPSM-F
* 3	019174-45	Sensor Cable Assembly
4	B-CV-F10	1.0 GPM Flow Reg CV Asm.
5	EC-FILTER	Replacement Filter
* 6	019944-45	ChekPoint Control Module w/ Filter Tee
* 7	5EF-0002C	AC Adapter - US Plug
8	5EF-0005	Supply Hose, 9/16-24 Female x 1/2" NPSM
9	5EF-0006	Mechanical Mixing Valve

\* For Versions Prior to 2021, Consult with T&S Customer Service

A Maximum of (8) ChekPoint Faucets can be Hardwire Connected and Powered by EC-HARDWIRE ChekPoint Hardwire AČ Transformer. (Sold Separately)



Flow Control DIP Switches are Located Behind Battery Compartment Cover.

- Switches are Set to DEFAULT Position:
  - Auto Time Out = 15 Seconds
  - Shut Off Delay = 1 Second
  - Auto Flush = OFF
  - Metering Mode = OFF

#### \*Available Water Flow Control Selections:

- Auto Time Out: 15 sec, 30 sec, 45 sec, 60 sec, 3 min, 20 min
- Shut Off Delay: 1 sec, 10 sec, 15 sec, 30 sec Auto Flush (30 Seconds After Every 12 Inactive Hours): ON or OFF
- Metering Mode: ON or OFF

#### **Product Specifications:**

Chrome Plated Brass Electronic Faucet: Single Hole, Deck Mount, Rigid Gooseneck w/ Plain End, AC/DC Control Module w/ Internal Flow Control Setting Switches, 1.0 GPM Flow Control Check Valve, Temperature Control Mixing Valve w/ Integral Check Valves & 18" Flexible Stainless Steel Supply Hoses

Product Compliance:

ASME A112.18.1 / CSA B125.1 NSF 61 - Section 9 NSF 372 (Low Lead Content) ANSI A117.1 (ADA) UL 1951

EPA WaterSense

Drawn: DMH Checked: JRM Approved: JHB Date: 04/05/22 Scale: NTS Sheet: 2 of 2