TES


T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

B-7222-C01XS1E

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

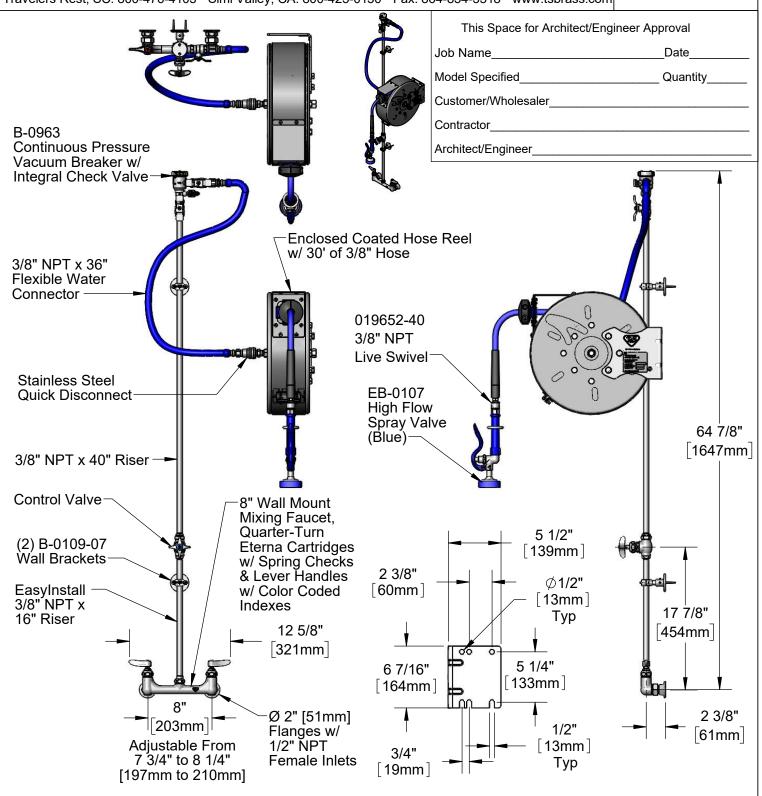

Product Specifications:

Enclosed Coated Hose Reel w/ 30' of 3/8" Hose, High Flow Spray Valve (Blue) w/ Swivel, Vacuum Breaker, 3/8" NPT Flexible Water Connector, 8" Wall Mount Mixing Faucet w/ Quarter-Turn Eterna Cartridges w/ Spring Checks & Control Valve

Product Compliance:

NSF 61 Exempt (Non-Potable) 2019 DOE PRSV Non-Compliant ASSE 1056 (VB)

Drawn: KJG Checked: MRC Approved: JHB Date: 08/20/20 Scale: 1:12 Sheet: 1 of 2




T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

B-7222-C01XS1E

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

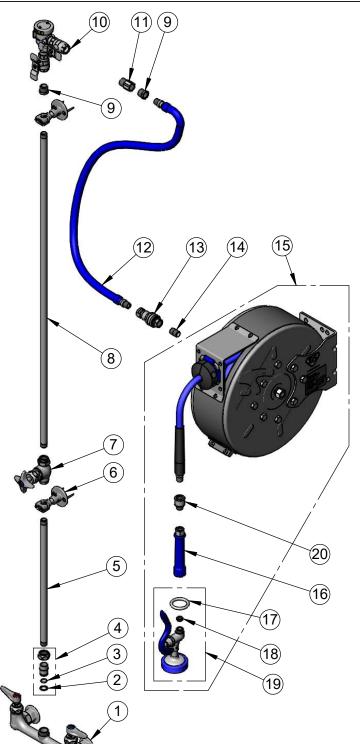

_			
	ITEM NO.	SALES NO.	DESCRIPTION
	1	B-0230-LN	8" Wall Mount Mixing Faucet
	2	014200-45	Star Washer, Anti-Rotation
	3	001065-45	O-Ring
	4	EZ-K	EasyInstall Kit
	5	000368-40	Nipple, 3/8" x 16"
	6	B-0109-07	Wall Bracket
	7	0RK3	Control Valve
	8	002558-40	3/8" NPT x 40" Riser
	9	001359-40	Hex Bushing, 1/2" NPT Male x 3/8" NPT Female
	10	B-0963	1/2" NPT Continuous Pressure Vacuum Breaker w/ Integral Check Valve
	11	015073-40	Check Valve w/ 1/2" NPT Adapter
	12	HW-2B-36	3/8" NPT x 36" Flexible Water Hose
	13	AW-5B	3/8" NPT Quick Disconnect
	14	002535-25	3/8" Close Nipple
	15	B-7222-C01	Enclosed Hose Reel w/ 3/8" x 30' Hose
	16	012504-40	Grip Handle (Blue), 3/8" NPT
	17	000907-45	Spray Valve Hold Down Ring
	18	010476-45	#27 Washer
	19	EB-0107	High Flow Spray Valve (Blue)
	20	019652-40	3/8" NPT Live Swivel

Product Specifications:

Enclosed Coated Hose Reel w/ 30' of 3/8" Hose, High Flow Spray Valve (Blue) w/ Swivel, Vacuum Breaker, 3/8" NPT Flexible Water Connector, 8" Wall Mount Mixing Faucet w/ Quarter-Turn Eterna Cartridges w/ Spring Checks & Control Valve

Product Compliance:

NSF 61 Exempt (Non-Potable) 2019 DOE PRSV Non-Compliant ASSE 1056 (VB)

Drawn: KJG Checked: MRC Approved: JHB Date: 08/20/20 Scale: NTS Sheet: 2 of 2