TES


T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

B-7232-U01XS2E

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

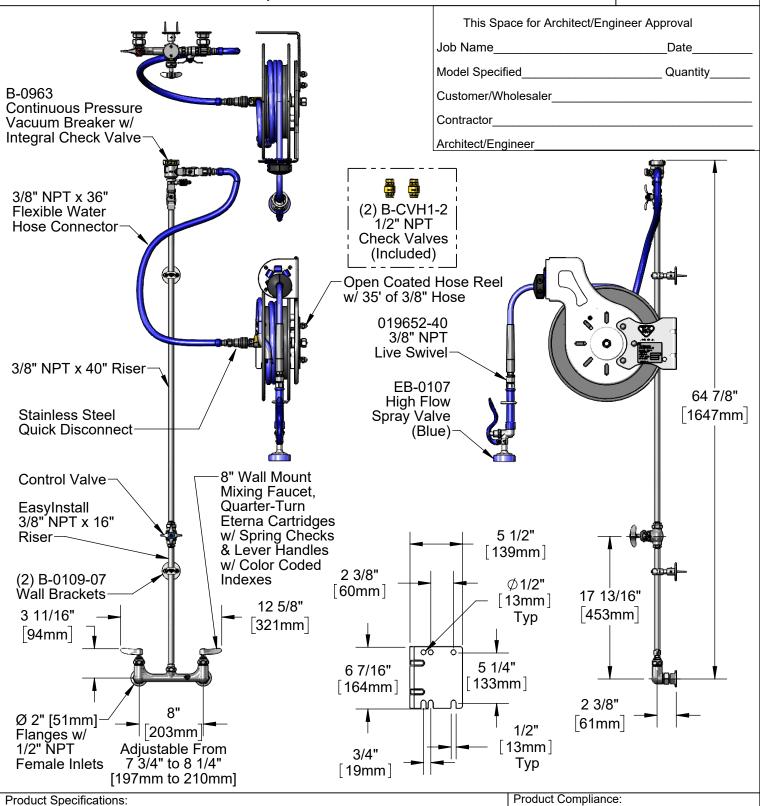

Open Coated Hose Reel w/ 35' of 3/8" Hose, High Flow Spray Valve w/ Swivel, Vacuum Breaker, 3/8" NPT Flexible Water Hose, 8" Wall Mount Mixing Faucet, 1/2" NPT Check Valves, Wall Brackets & Control Valve

NSF 61 Exempt (Non-Potable) 2019 DOE PRSV Non-Compliant ASSE 1056 (VB)

Drawn: JDR Checked: JMD Approved: JHB Date: 08/03/23 Scale: 1:12 Sheet: 1 of 2




T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

B-7232-U01XS2E

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

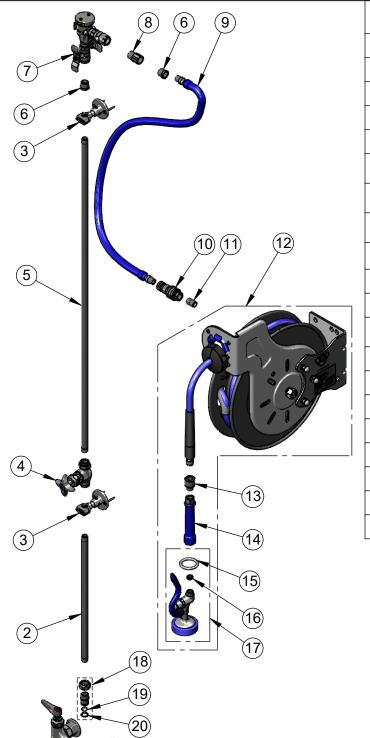

| NO. | SALES NO. | DESCRIPTION |
|-----|-----------|---|
| 1 | B-0230-LN | 8" Wall Mount Mixing Faucet |
| 2 | 000368-40 | Nipple, 3/8" x 16" |
| 3 | B-0109-07 | Wall Bracket |
| 4 | 0RK3 | Control Valve |
| 5 | 002558-40 | 3/8" NPT x 40" Riser |
| 6 | 001359-40 | Hex Bushing, 1/2" NPT Male x 3/8" NPT Female |
| 7 | B-0963 | Vacuum Breaker 1/2" NPT Female |
| 8 | 015073-40 | Check Valve w/ 1/2" NPT Adapter |
| 9 | HW-2B-36 | 3/8" NPT x 36" Flexible Water Hose |
| 10 | AW-5B | 3/8" NPT Quick Disconnect |
| 11 | 002535-25 | 3/8" Close Nipple |
| 12 | B-7232-01 | Open Stainless Steel Hose Reel w/ 35' of 3/8" Hose |
| 13 | 019652-40 | 3/8" NPT Live Swivel |
| 14 | 012504-40 | Grip Handle (Blue), 3/8" NPT |
| 15 | 000907-45 | Spray Valve Hold Down Ring |
| 16 | 010476-45 | #27 Washer |
| 17 | EB-0107 | High Flow Spray Valve (Blue) |
| 18 | EZ-K | EasyInstall Kit |
| 19 | 001065-45 | O-Ring |
| 20 | 014200-45 | Star Washer, Anti-Rotation |



<u>B-CVH1-2</u> 1/2" NPT Check Valve

Product Specifications:

(1)

Open Coated Hose Reel w/ 35' of 3/8" Hose, High Flow Spray Valve w/ Swivel, Vacuum Breaker, 3/8" NPT Flexible Water Hose, 8" Wall Mount Mixing Faucet, 1/2" NPT Check Valves, Wall Brackets & Control Valve

Product Compliance:

NSF 61 Exempt (Non-Potable) 2019 DOE PRSV Non-Compliant ASSE 1056 (VB)

Drawn: JDR Checked: JMD Approved: JHB Date: 08/03/23 Scale: NTS Sheet: 2 of 2