


This Space for Architect/Engineer Approval

Job Name _____ Date _____
 Model Specified _____ Quantity _____
 Customer/Wholesaler _____
 Contractor _____
 Architect/Engineer _____



ADA Compliant

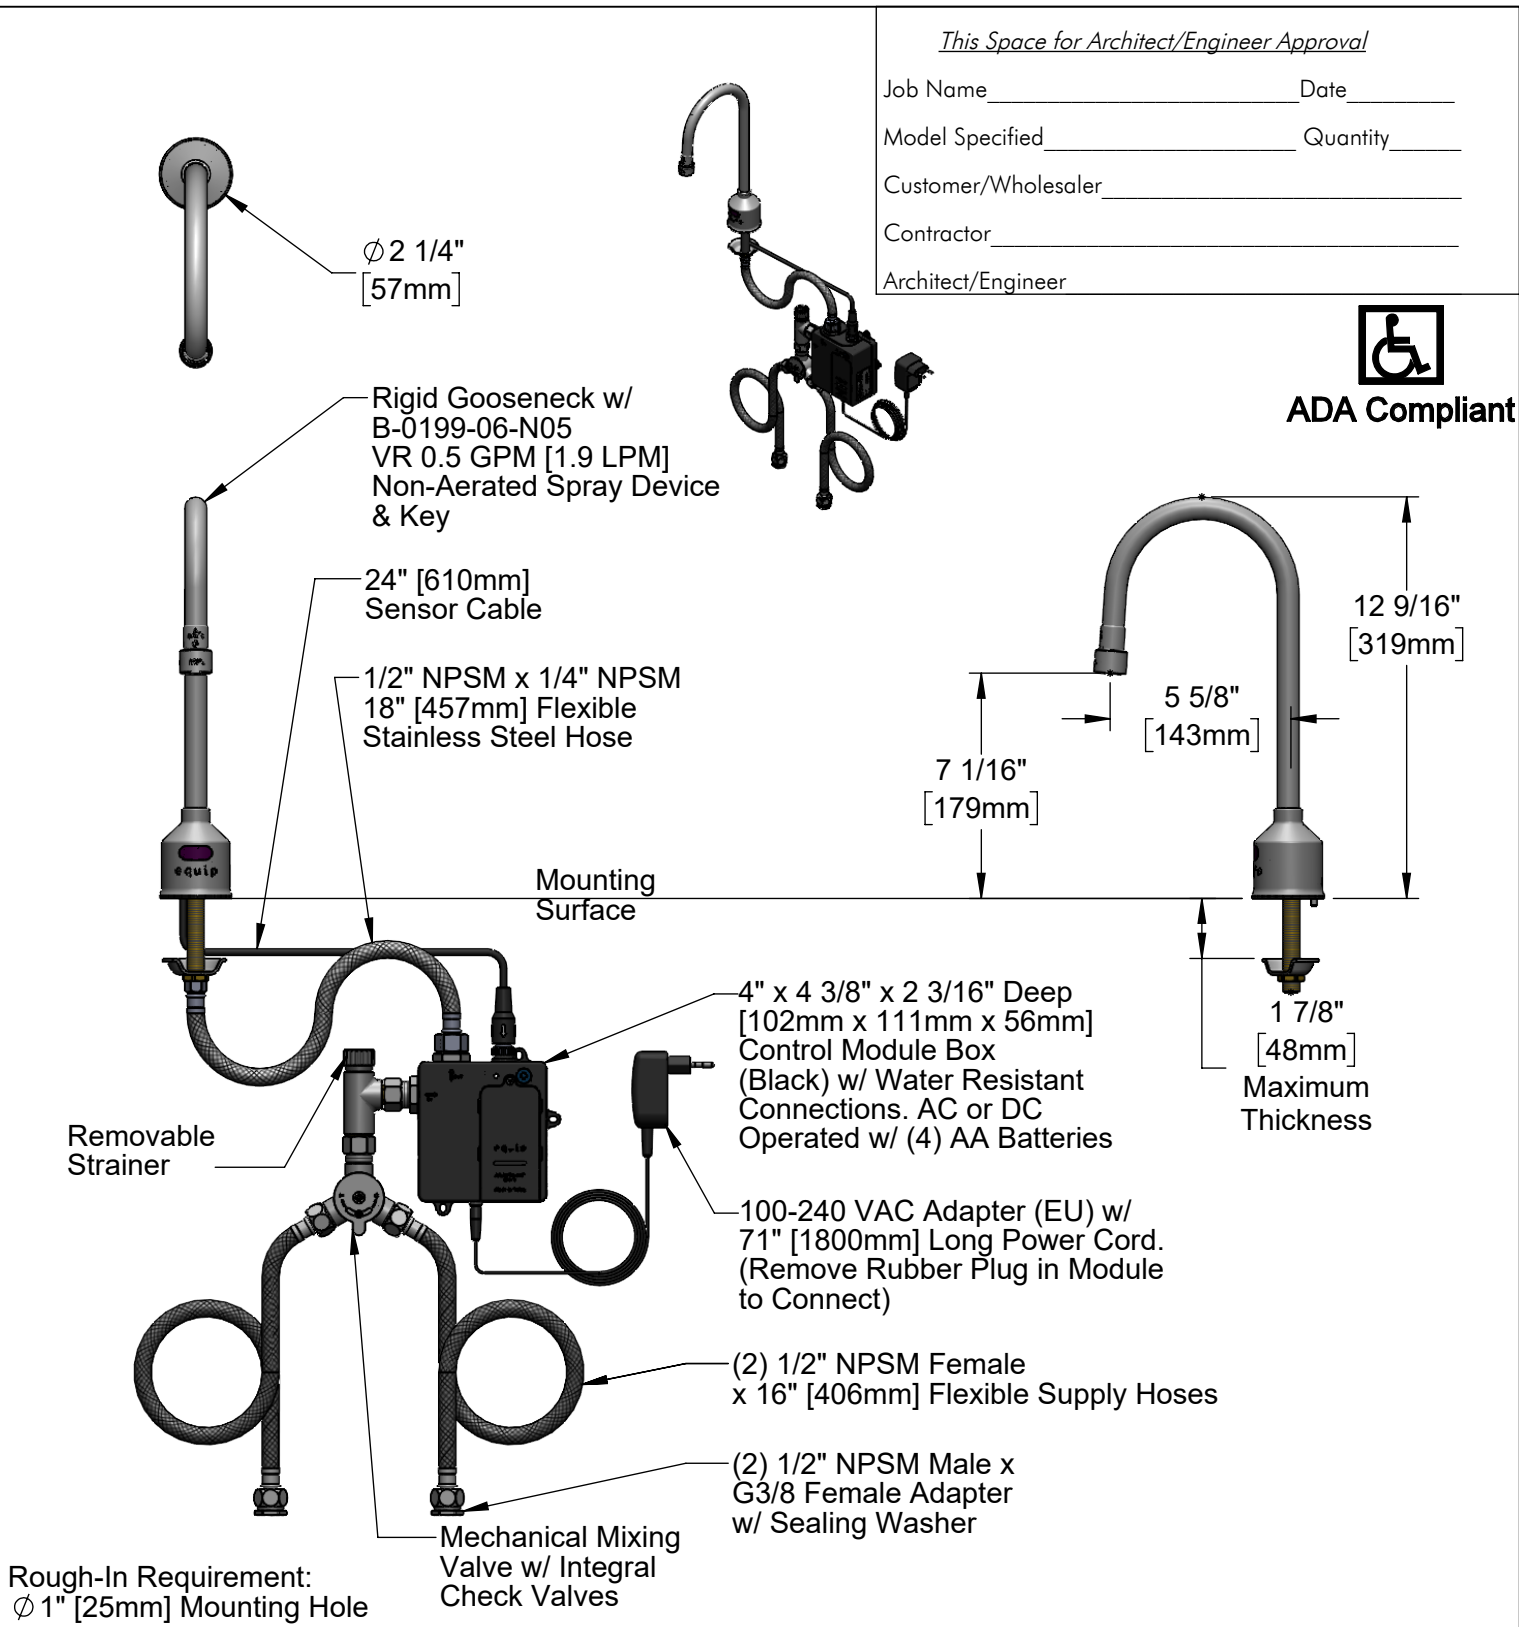

Model Number
5EF-EU1DG-VF05

Product Compliance:
 ASME A112.18.1 / CSA B125.1
 NSF 61 - Section 9
 NSF 372 (Low Lead Content)
 ANSI A117.1 (ADA)
 UL 1951


Product Specifications:
 equip Sensor Faucet: Deck Mount, Rigid Gooseneck w/ VR 0.5 GPM Non-Aerated Spray Device, EU Transformer, AC-DC Control Module, Temperature Control Mixing Valve w/ Integral Check Valves & Flexible Supply Hoses

equip
 Foodservice
 Accessories

2 Saddleback Cove, P.O. Box 1088
 Travelers Rest, South Carolina 29690
 Phone: 800.891.4808 Fax: 800.868.0084
 equip.tsbrass.com

ITEM NO.	SALES NO.	DESCRIPTION
1	015425-45	Vandal Resistant Key
2	B-0199-06-N05	VR 0.5 GPM Non-Aerated Spray Device, 55/64-27 UN Female w/ Key
* 3	5EF-0004C	Sensor Cable w/Curved Lens
4	016297-45	Inlet Hose, Faucet, 1/2" NPSM Female x 1/4" NPSM Female
* 5	5EF-0001C	equip Control Module (Black)
* 6	5EF-0011C	AC Adapter - EU Type Plug
7	016167-45	Supply Hose, 1/2" NPSM Female x 1/2" NPSM Female
8	5EF-0006	Temperature Mixing Valve
9	EC-FILTER	Replacement Filter
10	020498-25	Hex Bushing, G3/8 Female x 1/2" NPSM Male w/ Sealing Washer

* For Versions Prior to 2024, Consult with Customer Service

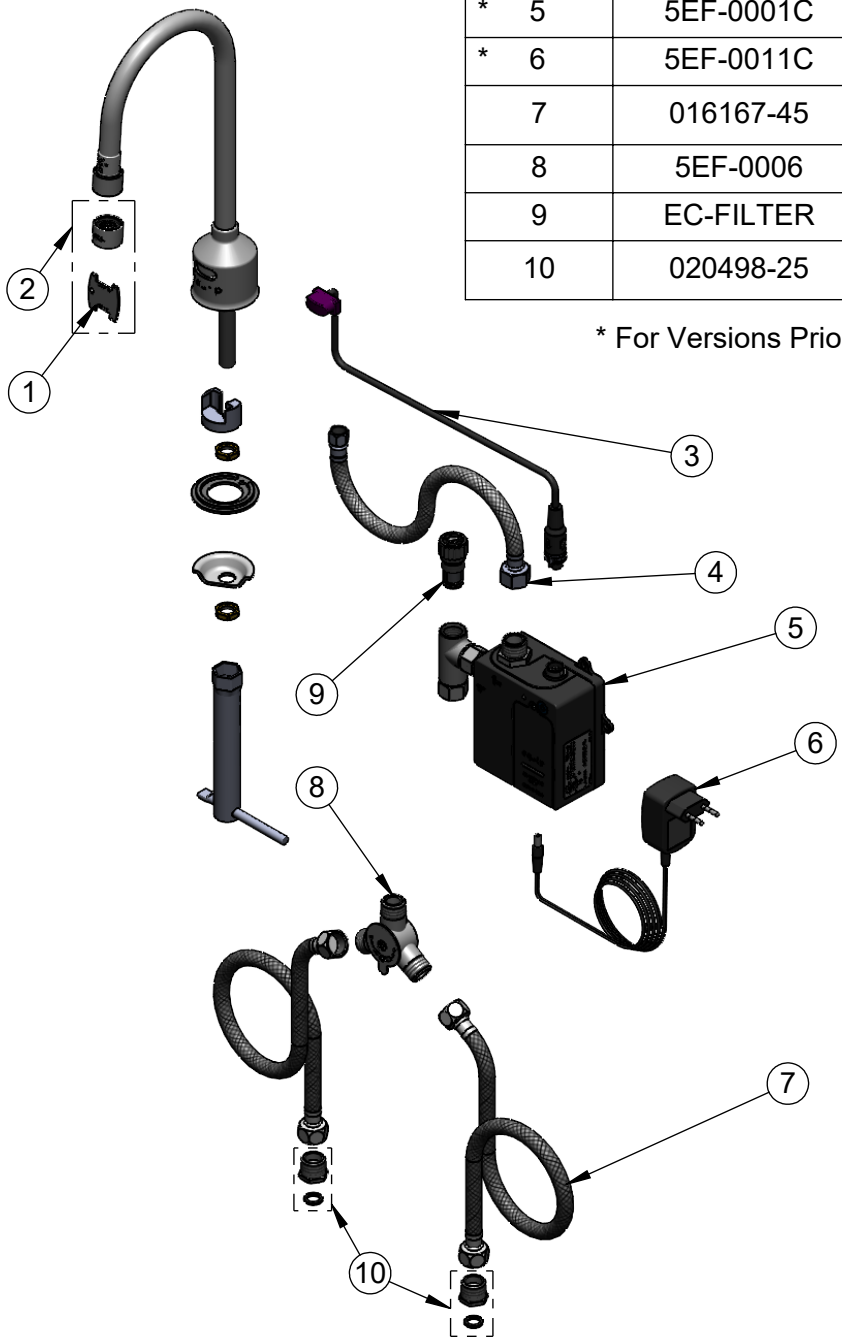

Model Number
5EF-EU1DG-VF05

Product Compliance:
ASME A112.18.1 / CSA B125.1
NSF 61 - Section 9
NSF 372 (Low Lead Content)
ANSI A117.1 (ADA)
UL 1951

Product Specifications:
equip Sensor Faucet: Deck Mount, Rigid Gooseneck w/ VR 0.5 GPM Non-Aerated Spray Device, EU Transformer, AC-DC Control Module, Temperature Control Mixing Valve w/ Integral Check Valves & Flexible Supply Hoses

equip
Foodservice
Accessories



2 Saddleback Cove, P.O. Box 1088
Travelers Rest, South Carolina 29690
Phone: 800.891.4808 Fax: 800.868.0084
equip.tsbrass.com