Tes


T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

CEF-4DS

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

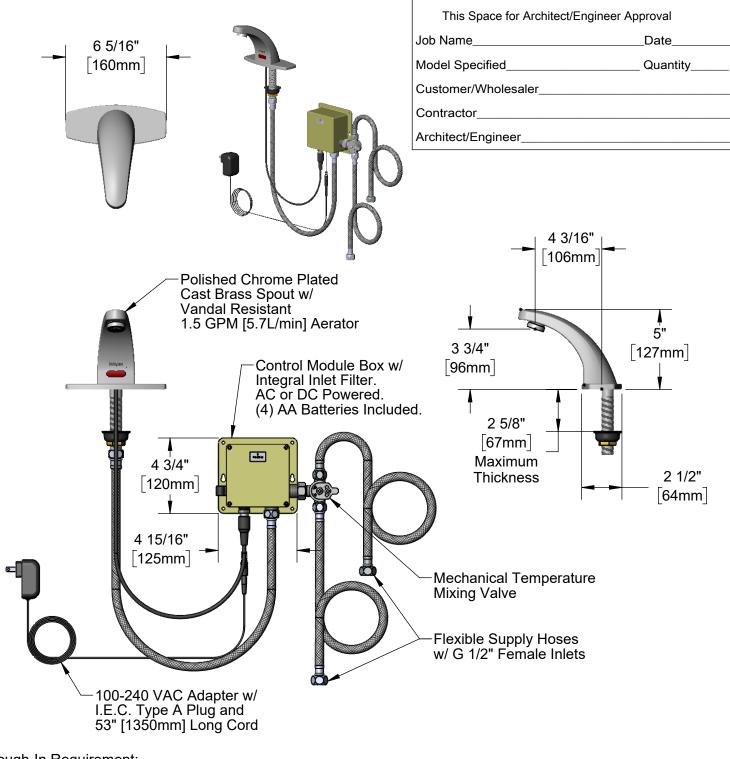

Rough-In Requirement: ∅ 1 1/4" [32mm] Mounting Hole

Product Specifications:

Single Hole Deck Mount Sensor Faucet w/ Cast Spout, Deck Plate, VR 1.5 GPM Aerator, Control Module, AC/DC Transformer, Mechanical Mixing Valve and G 1/2" Flexible Supply Hoses

Product Compliance:

| Drawn: | DMH | Checked: | JRM | Approved: | JHB | Date: | 01/26/23 | Scale: | 1:6 | Sheet: | 1 of 2 | |
|--------|-----|----------|-----|-----------|-----|-------|----------|--------|-----|--------|--------|--|
|--------|-----|----------|-----|-----------|-----|-------|----------|--------|-----|--------|--------|--|

T&S BRASS AND BRONZE WORKS, INC. 2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690


Model No.

CEF-4DS

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

| J , | | | | | | | |
|-------------|-----------------|--|--|--|--|--|--|
| ITEM NO. | SALES NO. | DESCRIPTION | | | | | |
| 1 | EU-0199-M24-V15 | VR 1.5 GPM Aerator, M24x1 Male | | | | | |
| 2 | 020377-45 | Sensor Cable | | | | | |
| 3 | 019920-45 | Control Module | | | | | |
| 4 | 019921-45 | Mechanical Temperature Mixing Valve | | | | | |
| 5 | 019922-45 | Supply Hose, G 3/8" x G 1/2" Connections | | | | | |
| 6 | 019924-45 | Plug-in AC Transformer | | | | | |
| 7 | 019927-45 | Supply Hose, G 1/2" Connections | | | | | |

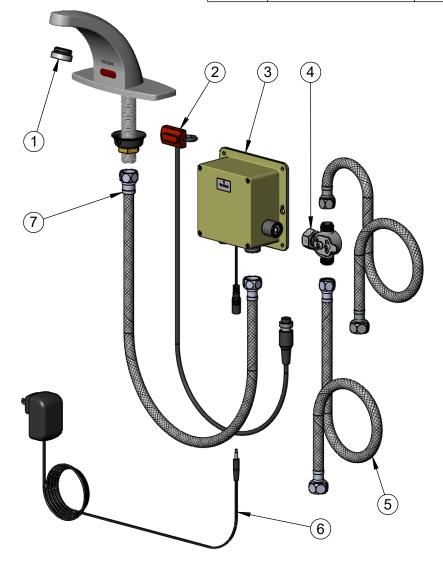

Product Specifications:

Single Hole Deck Mount Sensor Faucet w/ Cast Spout, Deck Plate, VR 1.5 GPM Aerator, Control Module, AC/DC Transformer, Mechanical Mixing Valve and G 1/2" Flexible Supply Hoses

Product Compliance:

| Drawn: | DMH | Checked: | JRM | Approved: | JHB | Date: | 01/26/23 | Scale: | NTS | Sheet: 2 of 2 | |
|--------|-----|----------|-----|-----------|-----|-------|----------|--------|-----|---------------|--|